



# Jøtul F 200

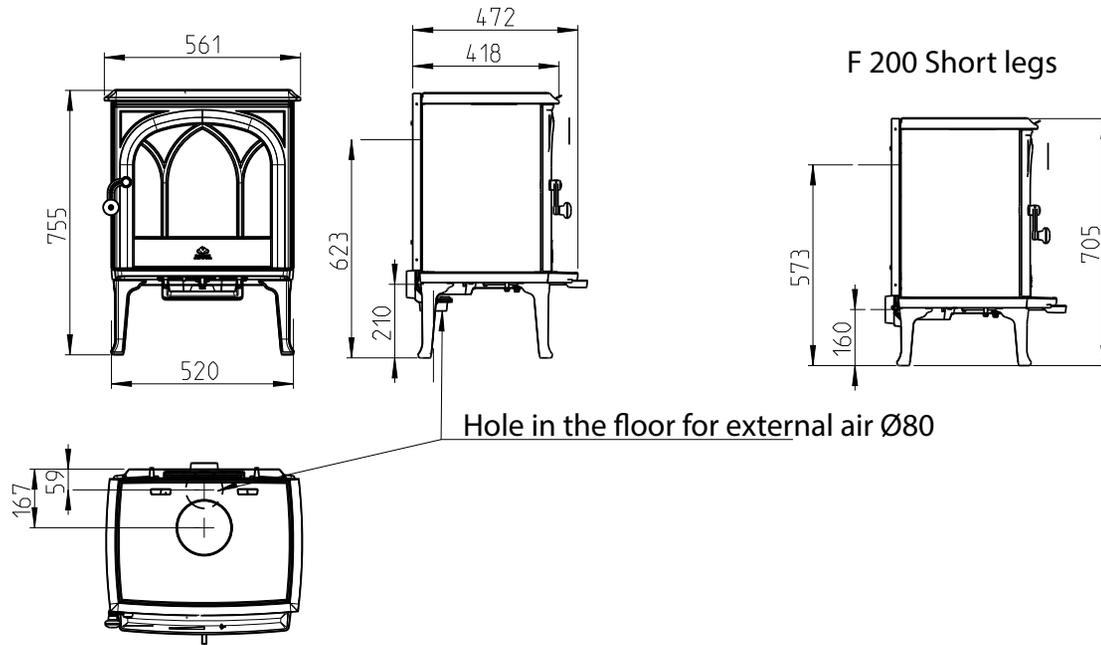

Hole in the floor for external air Ø80

Min. distance to ceiling and furniture


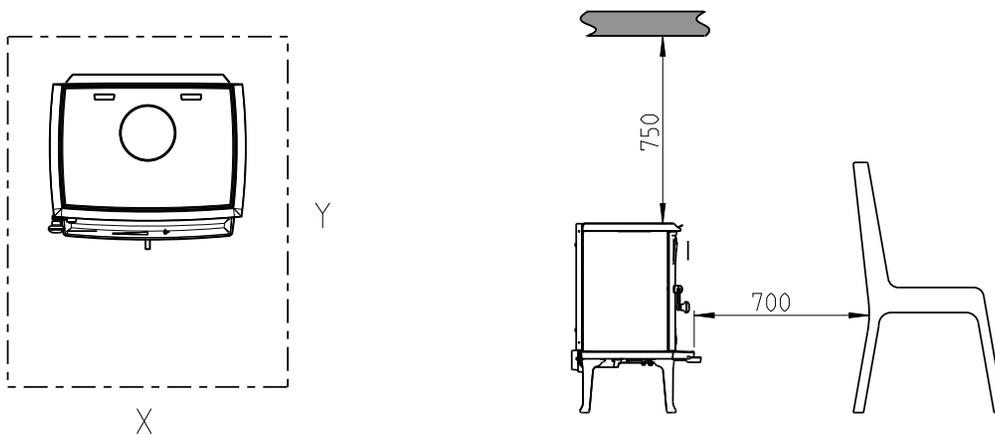


Min. measurements floor plate

X/Y = According to national laws and regulations

Min. distance to combustible wall

Semi isolated flue pipe/Cover flue pipe all the way down towards the product

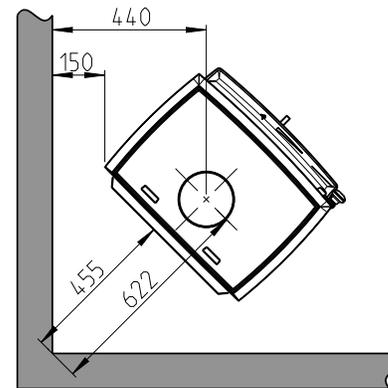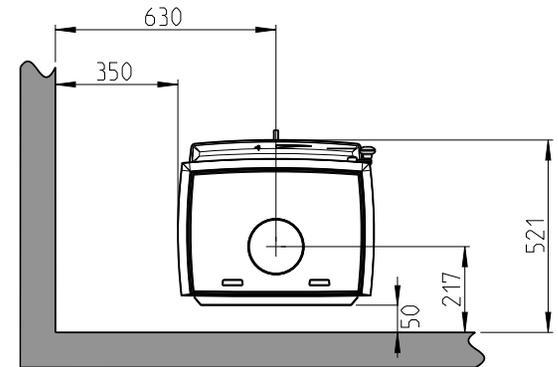

 Combustible wall


 Firewall (See chapter 3.3 in the manual)

# Jøtul F 200


Min. distance to combustibile wall protected by approved firewall

Semi isolated flue pipe/Cover flue pipe all the way down towards the product

## External firewall

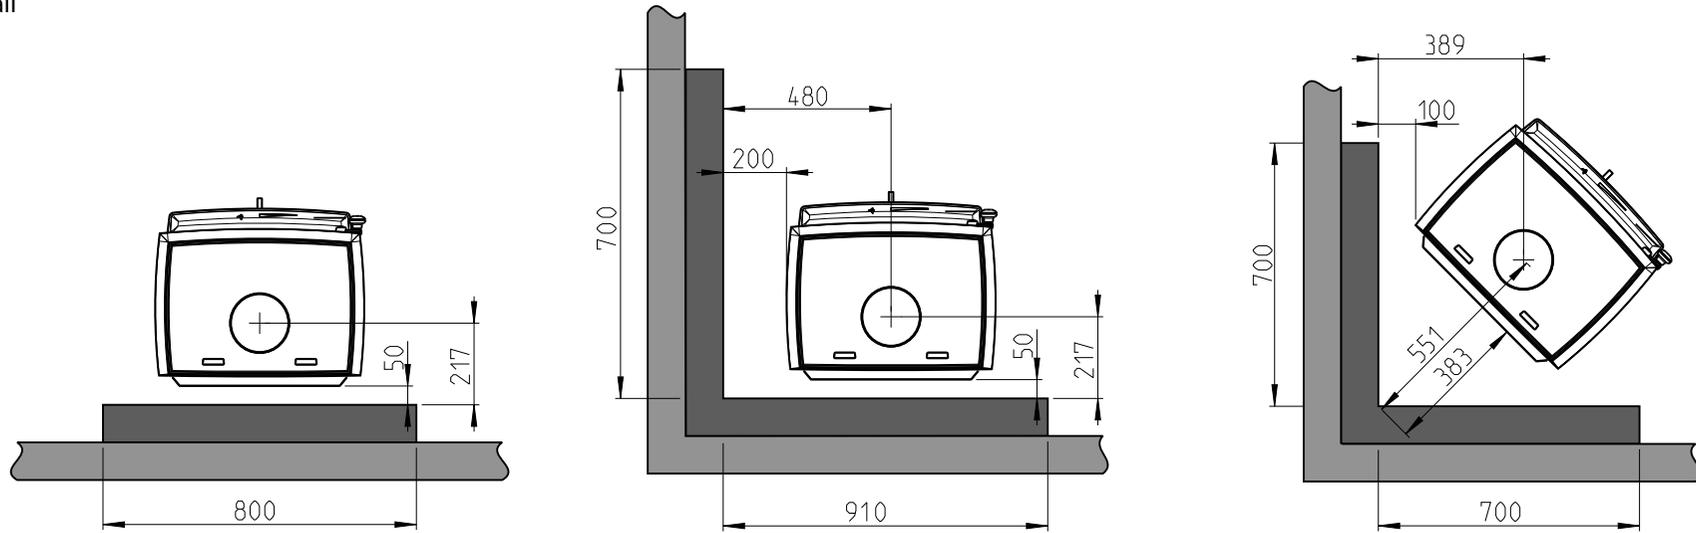

## Integrated firewall

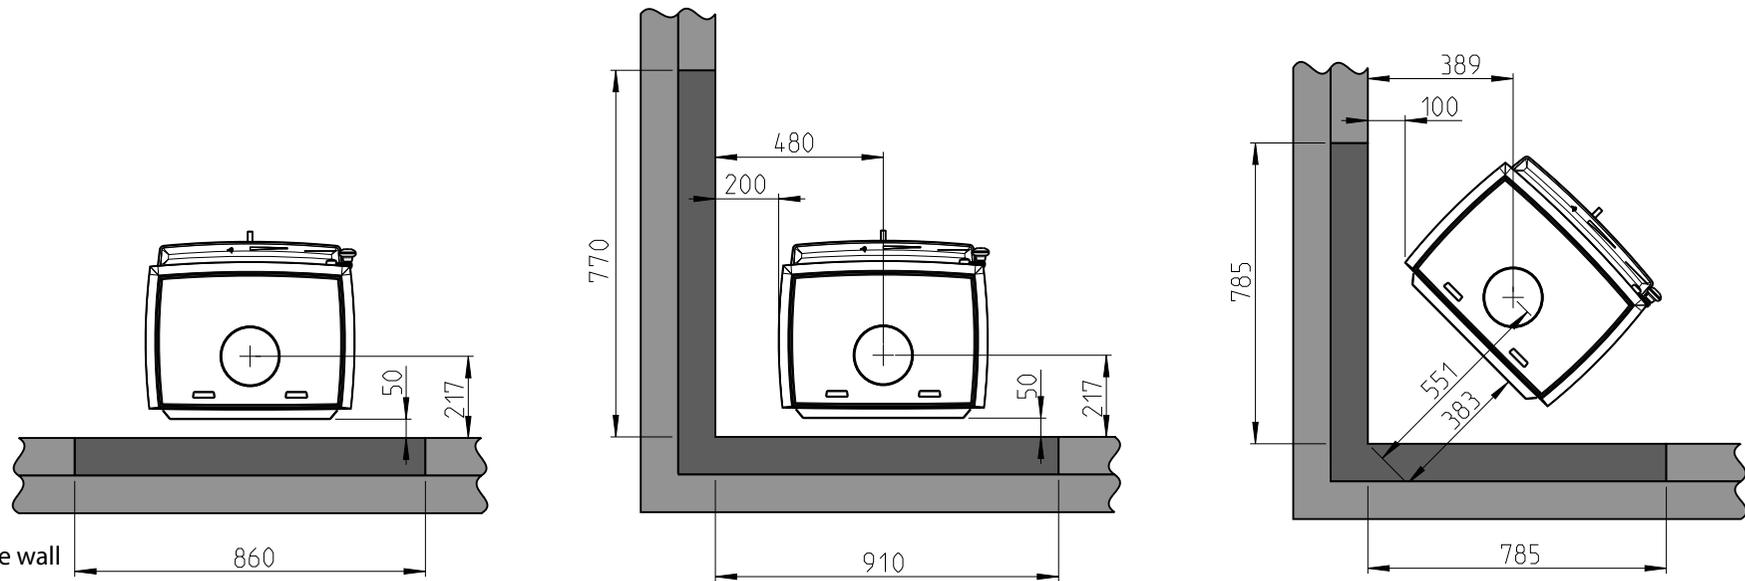

Combustible wall

Firewall (See chapter 3.3 in the manual)